

# SFP-4G85-SW

4.25Gbps SFP+ Transceiver, Multi Mode, 300m Reach



#### **Product Features**

- Supports up to 4.25Gbps bit rates
- Hot-pluggable SFP footprint
- ❖ 850nm VCSEL laser and PIN photodiode, Up to 300m for OM3-MMF transmission
- ❖ Compliant with SFP+ MSA and SFF-8472 with duplex LC receptacle
- Compatible with RoHS
- Single +3.3V power supply
- Real Time Digital Diagnostic Monitoring

FIBER MALL CO., LIMITED Rev 1.1 PAGE 1/9



Operating case temperature:

Standard: 0 to +70°C Industrial: -40 to +85°C

#### **Applications**

- 4.25Gbps Fibre Channel operation for FC-PI 400-M5-SN-I and 400-M6-SN-I
- ❖ 2.125Gbps Fibre Channel operation for FC-PI 200-M5-SN-I and 200-M6-SN-I
- ❖ 1.0625Gbps Fibre Channel operation for FC-PI 100-M5-SN-I and 100-M6-SN-I
- Other Optical links

#### **Description**

The SFP+ transceivers are high performance, cost effective modules supporting data rate of 4.25Gbps.

Link lengths at 4.25Gbps: 150 m with 50 um MMF, 70 m with 62.5 um MMF.


Link lengths at 2.125Gbps: 300 m with 50 um MMF, 150 m with 62.5 um MMF.

Link lengths at 1.0625Gbps: 500 m with 50 um MMF, 300 m with 62.5 um MMF.

The transceiver consists of three sections: a VCSEL laser transmitter, a PIN photodiode integrated with a trans-impedance preamplifier (TIA) and MCU control unit. All modules satisfy class I laser safety requirements.

The transceivers are compatible with SFP Multi-Source Agreement and SFF-8472 digital diagnostics functions.



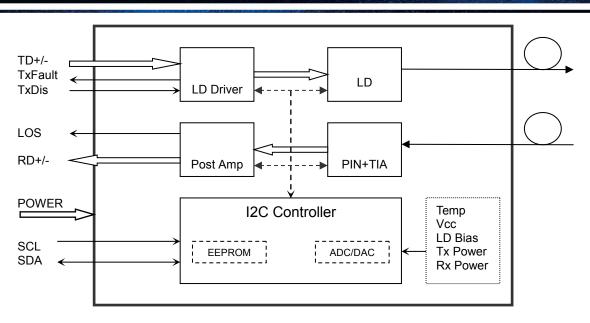

Transceiver functional diagram

## **Absolute Maximum Ratings**

Parameter	Symbol	Min	Max	Unit
Supply Voltage	Vcc	-0.5	4.5	V
Storage Temperature	Ts	-40	+85	°C
Operating Humidity	-	5	85	%

### **Recommended Operating Conditions**

Param	eter	Symbol	Min	Typical	Max	Unit
	Standard		0		+70	°C
Operating Case Temperature	Extended	Тс	-20		+80	°C
·	Industrial		-40		+85	°C
Power Suppl	y Voltage	Vcc	3.135	3.30	3.465	V
Power Supp	ly Current	Icc			260	mA
Data R	Rate		1.0		4.25	Gbps

FIBER MALL CO., LIMITED Rev 1.1 PAGE 3/9



## **Optical and Electrical Characteristics**

Param	eter	Symbol	Min	Typical	Max	Unit	Notes
	Transmitter						
Centre Wa	velength	λс	840	850	860	nm	
Spectral Widt	h (RMS)	Δλ			0.85	nm	
Side-Mode Supp	ression Ratio	SMSR	-	-	-	dB	
Average Out	put Power	Pout	-9.0		0	dBm	1
Extinction	n Ratio	ER	3.0			dB	
Data Input Swir	g Differential	V <sub>IN</sub>	180		950	mV	2
Input Differentia	al Impedance	Z <sub>IN</sub>	90	100	110	Ω	
TV Disable	Disable		2.0		Vcc	V	
TX Disable	Enable		0		0.8	V	
TV F#	Fault		2.0		Vcc	V	
TX Fault	Normal		0		0.8	V	
			Receiver				
Centre Wavelength		λς	840	850	860	nm	
Receiver S	ensitivity				-15	dBm	3
Receiver C	Overload		0.5			dBm	3
LOS De-Assert		LOS <sub>D</sub>			-16	dBm	
LOS Assert		LOSA	-30			dBm	
LOS Hysteresis			0.5		4	dB	
Data Outpu Differe	Data Output Swing Differential		500	700	900	mV	4
LOS		High	2.0		Vcc	V	
		Low			0.8	V	

#### Notes:

- 1. The optical power is launched into MMF.
- 2. PECL input, internally AC-coupled and terminated.
- 3. Measured with a PRBS 2<sup>31</sup>-1 test pattern @4250Mbps, BER ≤1×10<sup>-12</sup>.
- 4. Internally AC-coupled.

FIBER MALL CO., LIMITED Rev 1.1 PAGE 4/9



# **Timing and Electrical**

Parameter	Symbol	Min	Typical	Max	Unit
Tx Disable Negate Time	t_on			1	ms
Tx Disable Assert Time	t_off			10	μs
Time To Initialize, including Reset of Tx Fault	t_init			300	ms
Tx Fault Assert Time	t_fault			100	μs
Tx Disable To Reset	t_reset	10			μs
LOS Assert Time	t_loss_on			100	μs
LOS De-assert Time	t_loss_off			100	μs
Serial ID Clock Rate	f_serial_clock		100	400	KHz
MOD_DEF (0:2)-High	V <sub>H</sub>	2		Vcc	V
MOD_DEF (0:2)-Low	VL			0.8	V

# **Diagnostics**

Parameter	Range	Unit	Accuracy	Calibration	
	0 to +70				
Temperature	-20 to +80	° C	±3° C	Internal	
	-40 to +85				
Voltage	3.0 to 3.6	V	±3%	Internal	
Bias Current	0 to 15	mA	±10%	Internal	
TX Power	-9.0 to 0	dBm	±3dB	Internal	
RX Power	-16 to -1	dBm	±3dB	Internal	




#### **Digital Diagnostic Memory Map**

The transceivers provide serial ID memory contents and diagnostic information about the present operating conditions by the 2-wire serial interface (SCL, SDA).

The diagnostic information with internal calibration or external calibration all are implemented, including received power monitoring, transmitted power monitoring, bias current monitoring, supply voltage monitoring and temperature monitoring.


The digital diagnostic memory map specific data field defines as following.

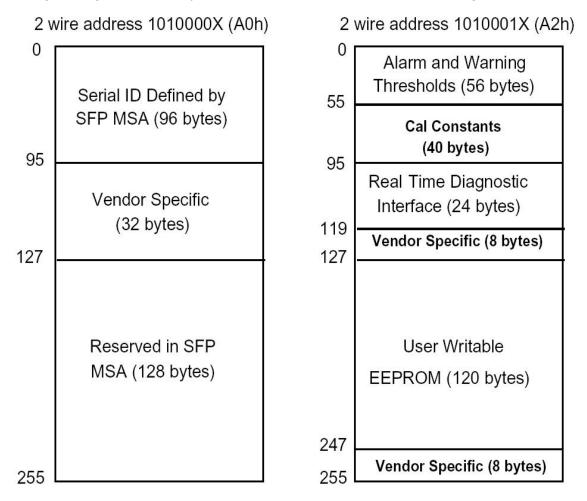

FIBER MALL CO., LIMITED Rev 1.1 PAGE 6/9



## **Pin Descriptions**

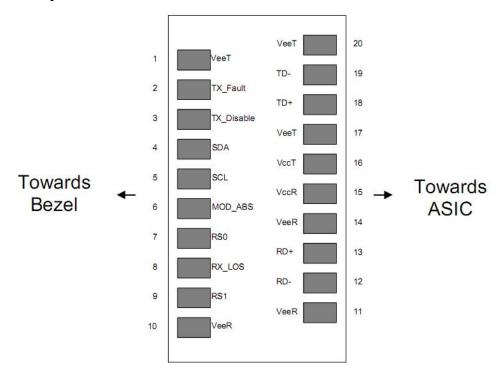

Pin	Signal Name	Description	Plug Seq.	Notes
1	V <sub>EET</sub>	Transmitter Ground	1	
2	TX FAULT	Transmitter Fault Indication	3	Note 1
3	TX DISABLE	Transmitter Disable	3	Note 2
4	SDA	SDA Serial Data Signal	3	
5	SCL	SCL Serial Clock Signal	3	
6	MOD_ABS	Module Absent. Grounded within the module	3	
7	RS0	Not Connected	3	
8	LOS	Loss of Signal	3	Note 3
9	RS1	Not Connected	3	
10	V <sub>EER</sub>	Receiver ground	1	
11	VEER	Receiver ground	1	
12	RD-	Inv. Received Data Out	3	Note 4
13	RD+	Received Data Out	3	Note 4
14	V <sub>EER</sub>	Receiver ground	1	
15	V <sub>CCR</sub>	Receiver Power Supply	2	

FIBER MALL CO., LIMITED Rev 1.1 PAGE 7/9




16	V <sub>CCT</sub>	Transmitter Power Supply	2	
17	V <sub>EET</sub>	Transmitter Ground	1	
18	TD+	Transmit Data In	3	Note 5
19	TD-	Inv. Transmit Data In	3	Note 5
20	V <sub>EET</sub>	Transmitter Ground	1	

#### Notes:

Plug Seq.: Pin engagement sequence during hot plugging.


- 1) TX Fault is an open collector output, which should be pulled up with a 4.7k~10kΩ resistor on the host board to a voltage between 2.0V and Vcc+0.3V. Logic 0 indicates normal operation; Logic 1 indicates a laser fault of some kind. In the low state, the output will be pulled to less than 0.8V.
- 2) Laser output disabled on TDIS >2.0V or open, enabled on TDIS <0.8V.
- 3) LOS is open collector output. Should be pulled up with 4.7k~10kΩ on host board to a voltage between 2.0V and 3.6V. Logic 0 indicates normal operation; logic 1 indicates loss of signal.
- 4) RD-/+: These are the differential receiver outputs. They are internally AC-coupled 100 differential lines which should be terminated with  $100\Omega$  (differential) at the user SERDES.
- 5) TD-/+: These are the differential transmitter inputs. They are internally AC-coupled, differential lines with  $100\Omega$  differential termination inside the module.


#### **Recommended Interface Circuit**

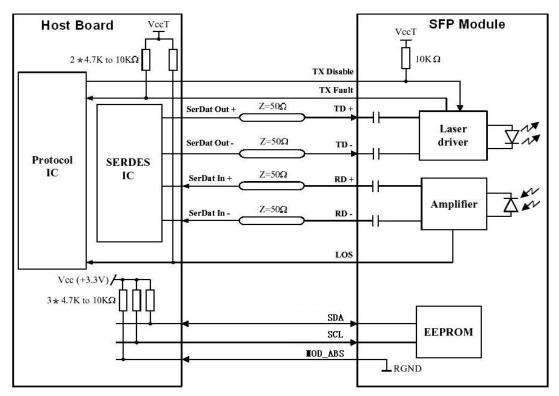



#### **Mechanical Dimensions**

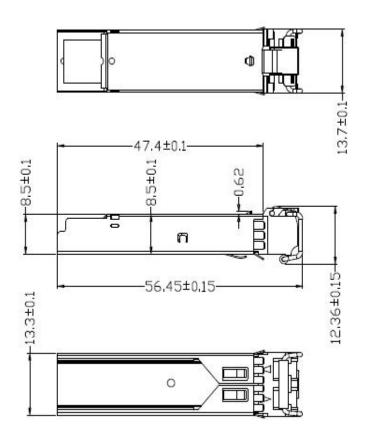



# **Ordering Information**

Part Number	Product Description
SFP-4G85-SW	850nm, 4.25Gbps, LC, 300m, 0°C~+70°C, with DDM
SFP-4G85-SWI	850nm, 4.25Gbps, LC, 300m, -40°C~+85°C, with DDM

FIBER MALL CO., LIMITED Rev 1.1 PAGE 9/9